
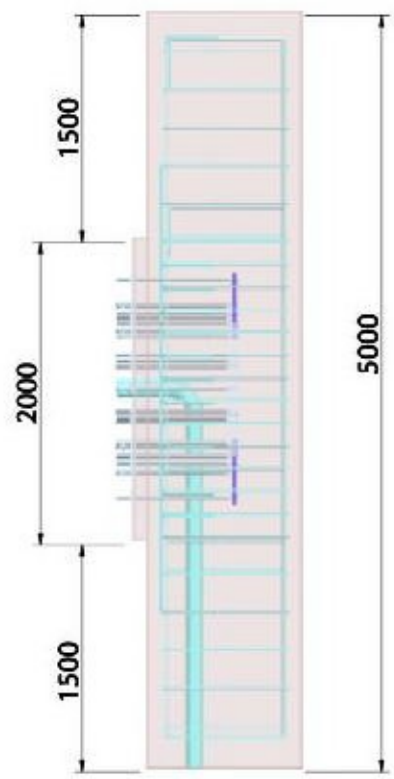


REV	NPI #	SUMMARY OF CHANGES	DATE	BY	CHK'D
A	-	INITIAL RELEASE	03-Aug-10	CO'N	-

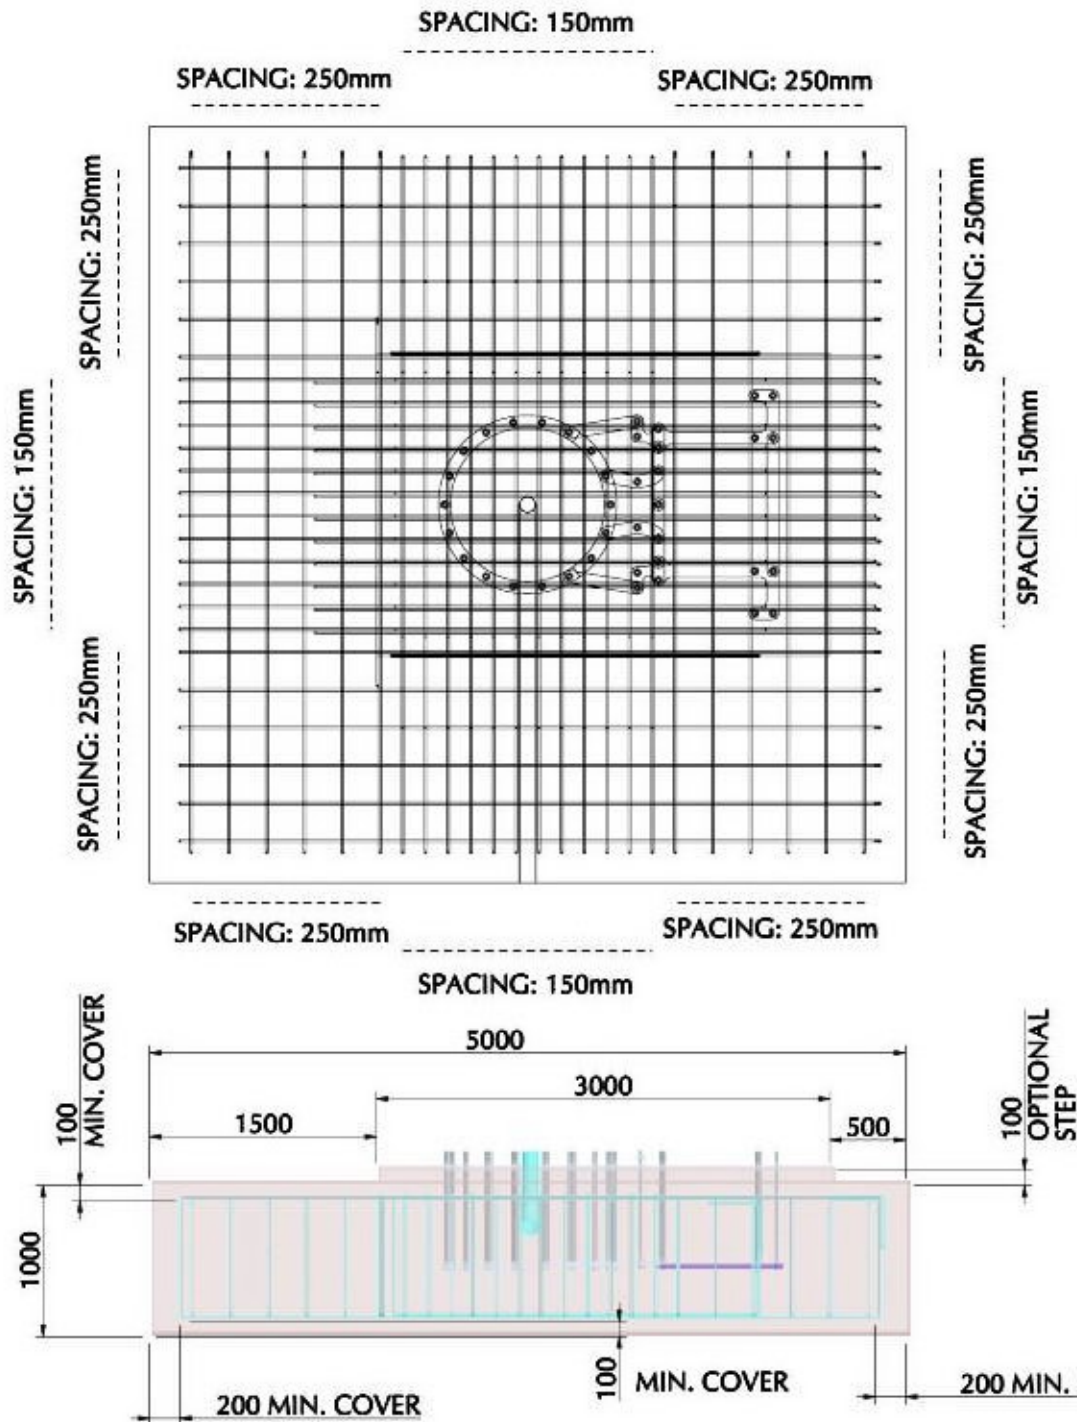

Town & Country Planning
(Scotland) Act, 1997
as amended

REFUSED
28/06/11

Development Management
Environmental Services
The Moray Council

1. FOUNDATION DESIGN BASED UPON ALLOWABLE NET SOIL BEARING PRESSURE OF MIN. 100kN/sq.m
2. MINIMUM COVER TO BE 100mm.
3. CONCRETE TO BE C35 TO BS8110 USING OPC AND 20mm MAX. AGGREGATE SIZE.
4. MAX. FREE WATER/CEMENT RATIO 0.55.
5. MINIMUM CEMENT CONTENT OF 325 Kg/m.
6. MONOPOLE BASEPLATE, TEMPLATES, DUCTING AND BOLTING ARRANGEMENT DETAILED SEPARATELY.
7. DUCTING TO BE A MAXIMUM OF 110mm DIAMETER
8. FOUNDATION SIZES FOR 20kW TURBINE: 5.0x5.0x1.0m (25 CU. METRES) [CLASS 1]

C&F Green-Energy		PART NUMBER: A-0920	
DESCRIPTION: 5.0 SQ. FOUNDATION		QTY PER UNIT: 1	SCALE: -
MATERIAL:	-	 DWG SIZE: A4 <small>INDICATING COORDINATE AND FULL GRID</small>	 <small>INDICATING SCALE AND FULL GRID</small>
DRAWN:	C O'Neill		
CHECKED:	-	FINISH:	-
DATE:	03-Aug-10	SHEET:	1 OF 1